

# 1. 4-Way Cassette (Type U2)


#### 1-3. Dimensional Data


Indoor Units: S-22MU2E5C, S-28MU2E5C, S-36MU2E5C, S-45MU2E5C, S-56MU2E5C, S-60MU2E5C

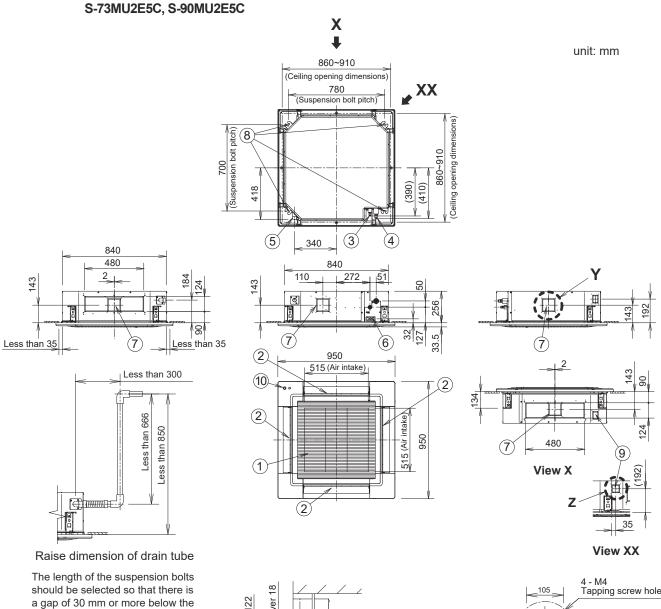

The length of the suspension bolts should be selected so that there is a gap of 30 mm or more below the lower surface of the ceiling (18 mm or more below the lower surface of the main unit), as shown in the figure at right. If the suspension bolt is too long, it will contact the ceiling panel and the unit cannot be installed.






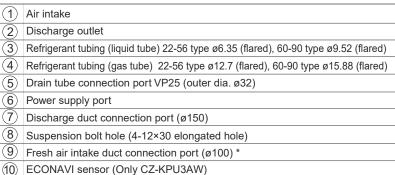


<sup>\*</sup> Necessary to attach duct connecting flange(field supplied).

### <Filter dimension>

520 × 520 × 15




Detailed view Y



Detailed view Z

# 1. 4-Way Cassette (Type U2)

### Indoor Units: S-106MU2E5C, S-112MU2E5C, S-140MU2E5C, S-160MU2E5C

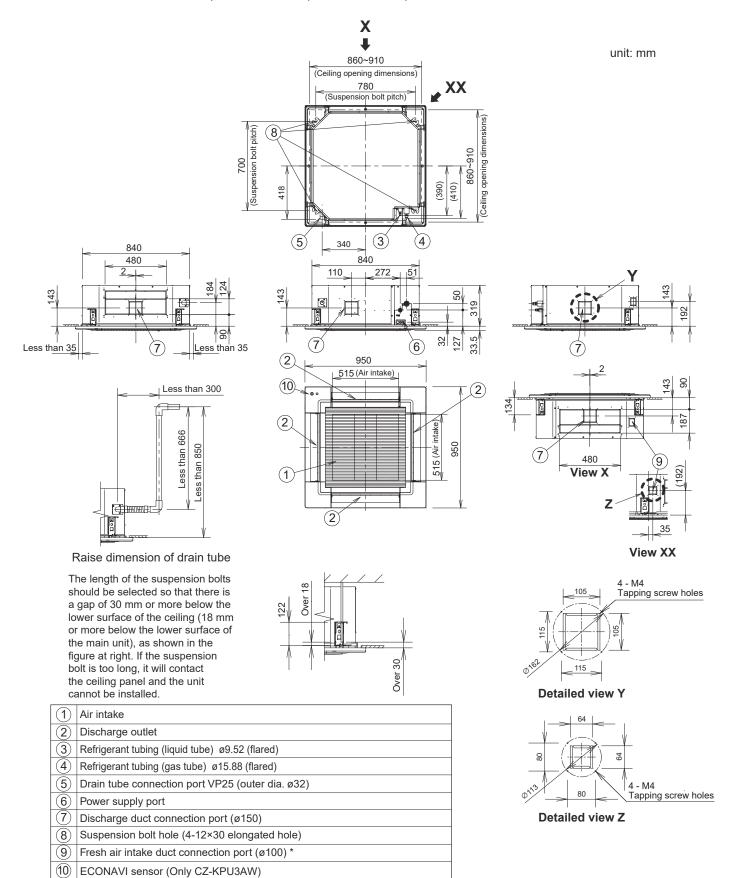

Necessary to attach duct connecting flange(field supplied).

<Filter dimension>

520 × 520 × 15